


# Executive Order G-70-163-AA

## Exhibit 2

**Figure 2B-3**

### Typical Installation of the OPW VaporEZ Phase II Vapor Recovery System With Two-Point Phase I System

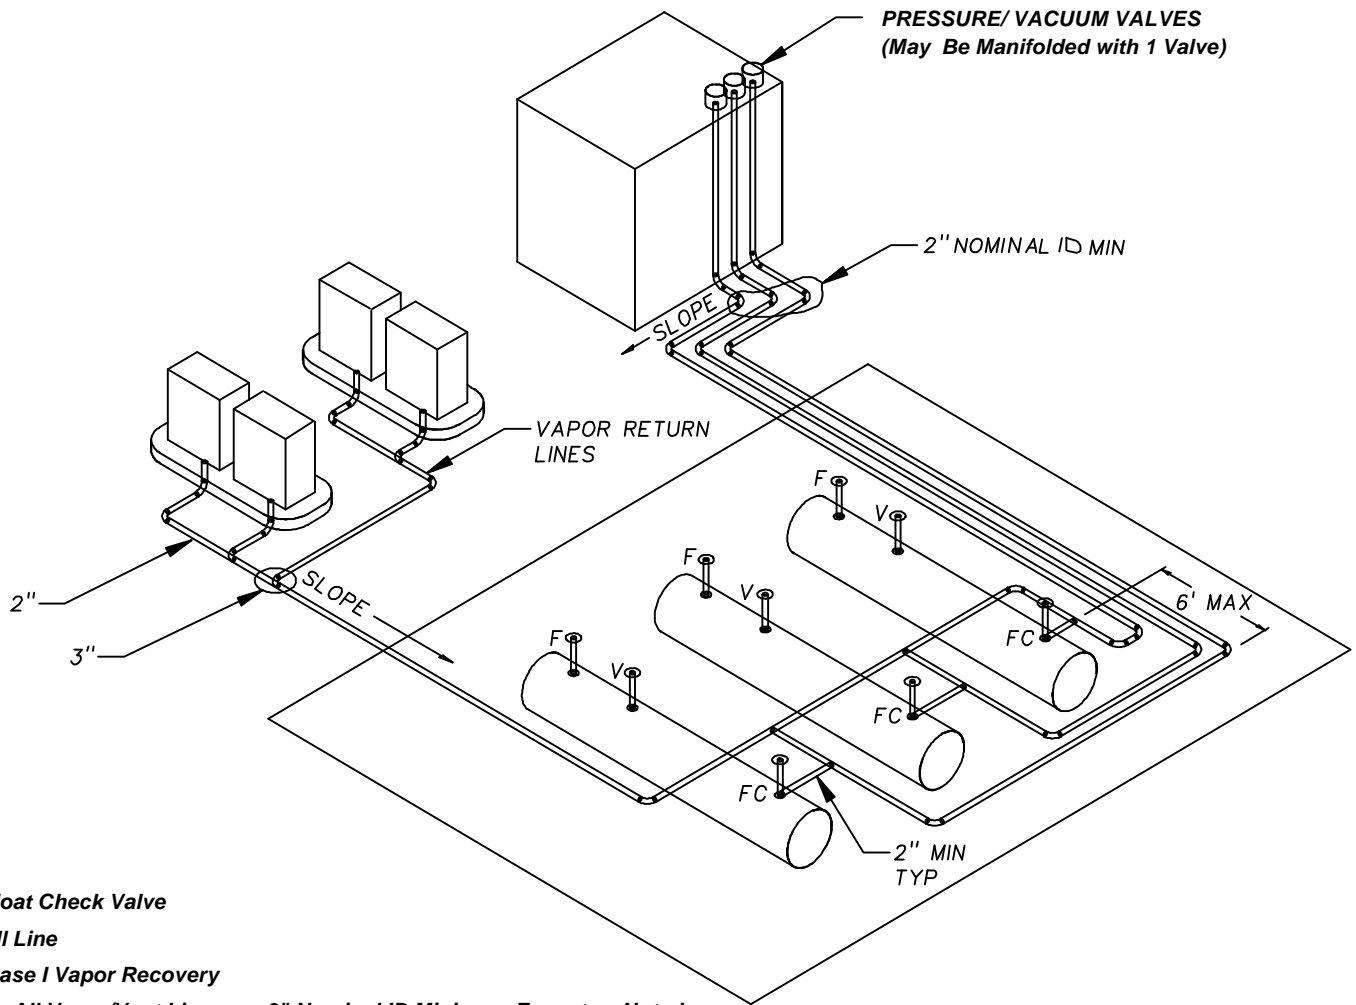

**FC = Float Check Valve**

**F = Fill Line**

**V = Phase I Vapor Recovery**

**Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum Except as Noted**

**2. Slope: 1/8" per foot Min.**

**1/4" per Foot Preferred**

**3. Maintain 2'0" Clearance Between Fill Line and  
Phase I Vapor Return Line to Truck**